



## PERFORMANCE ANALYSIS AND ENERGY AUDIT ON BOILER LOSSES IN THERMAL POWER PLANT

**Mr. N Sai Ravi Varma**, PG Student, Department of Mechanical Engineering, Nadimpalli Satyanarayana Raju Institute of Technology, Visakhapatnam.

**Mrs. B Usha Rani**, Sr. Assistant Professor, Department of Mechanical Engineering, Nadimpalli Satyanarayana Raju Institute of Technology, Visakhapatnam.

### Abstract:

Energy audit is the study of energy consumption process and find the better path to reduce the consumption for energy saving. For doing the energy audit Kottagudem Thermal Power Station, Stage VII-1 X 800 MW Coal based thermal power plant was selected. It is a super critical boiler. In this work, energy audit is done in a boiler to identify the few losses. In that, one of that, heat loss due to dry flue gas which become barrier to heat transfer in economizer section which is at boiler second pass in power plant. Due to this heat loss, water is not preheated properly, it may effect on the efficiency of the boiler as well as fuel consumption of the boiler.

In this work, different parameters were measured such as Consumption of coal, Pressure of the steam, Coal Calorific Value, Temperature of flue gases which is generated at the boiler, Proximate analysis of coal etc., The prime objective of this work is to reduce the heat loss due to dry flue gasses by modifying the existing system that is steam based soot blowers. Here working medium is steam. By using the steam to clean the flue gases which is surrounded at the economizer coils. But this existing process is not sufficient to reduce the heat loss and it is economical. So, modification is required in working medium and in machine (Soot Blower).

In this modification, medium is changed from steam to hot air. So, it is efficiently clean the flue gases in economizer coils and improve the heat transfer rate. Along with this upgrade the soot blower lance and speed. Now medium is air it cheap and easily available so there is no need to use steam. Due to this save the energy and coal. It impacts the boiler and overall plant efficiency. But problem with this process is not much economical for applying the existing power plant why because major changes will do in boiler section, so it is highly recommended for upcoming thermal power plants.

### Keywords:

Thermal Power Plant, Energy Audit, Boiler Efficiency, Soot Blowers, Heat Losses.

### 1. Introduction:

In India, electricity generation stems from two main categories: conventional and non-conventional sources. Conventional sources encompass thermal (such as coal, lignite, natural gas, and oil), hydro, and nuclear power. On the other hand, non-conventional sources, also known as renewable energy sources, comprise solar, wind, agricultural, and domestic waste, among others.

India relies heavily on fossil fuels for its energy needs, with about 60% of its energy generation capacity coming from sources like coal, crude oil, and natural gas. Coal consumption alone accounts for 48.8% of India's total energy consumption, followed by crude oil at 24% and natural gas at 6%. To meet its energy demands, India depends on importing fossil fuels, which are projected to exceed 53% of the country's total energy consumption. In 2009-10, India imported 159.26 million tons of crude oil, amounting to 80% of its domestic consumption, and these oil imports constituted 31% of the country's total imports.

The demand for electricity in India faces challenges due to domestic coal shortages, leading to an 18% increase in coal imports for electricity generation in 2010. Despite these challenges, India's energy market is one of the world's fastest growing, driven by rapid economic expansion. It is expected to be the second-largest contributor to the global increase in energy demand by 2035. However, India's



limited domestic fossil fuel reserves necessitate a shift towards renewable energy sources and nuclear power.

India has ambitious plans to expand its renewable energy capacity, aiming to add about 20GW of solar power and increase the contribution of nuclear power to overall electricity generation capacity from 4.2% to 9%. Currently, the country has five nuclear reactors under construction, and it ranks third globally in electricity generation from nuclear power. India plans to construct 18 additional nuclear reactors by 2025, aiming to become the second-highest generator of nuclear electricity worldwide.

The performance of boilers, crucial for energy generation, deteriorates over time due to factors like poor combustion, heat transfer fouling, and inadequate operation and maintenance. Additionally, the deterioration of fuel quality and water quality can lead to decreased boiler performance. Efficiency testing is essential to evaluate the current level of boiler efficiency and identify any deviations from optimal efficiency, enabling corrective action for energy conservation in industries.

## **2. THE OBJECTIVE OF CONDUCTING A PERFORMANCE TEST:**

1. Evaluating Boiler Efficiency: This process entails assessing how efficiently the boiler transforms fuel into usable energy.

2. Calculating the Evaporation Ratio: This metric helps determine the quantity of steam produced per unit of fuel utilized, offering a measure of the boiler's operational efficiency.

Conducting a performance test is essential for comprehending the actual functionality and effectiveness of the boiler, enabling comparisons against design specifications or industry benchmarks. It facilitates the monitoring of fluctuations in boiler efficiency over time, aiding in the identification of potential opportunities for energy efficiency improvements.

## **3. Boiler efficiency can typically be evaluated through two primary approaches:**

1. Direct Methodology: This method entails directly comparing the energy extracted by the working fluid (consisting of water and steam) with the energy content of the boiler fuel.

2. Indirect Methodology: In this approach, efficiency is determined by analysing the disparity between losses incurred during boiler operation and the energy input supplied.

By utilizing these methodologies, stakeholders can acquire valuable insights into the operational efficiency of the boiler, thereby guiding decisions aimed at optimizing energy utilization and enhancing overall performance.

## **4. LOSS OF HEAT CALCULATIONS:**

### **4.1 DIRECT METHOD**

To determine boiler efficiency, the direct method is often preferred due to its simplicity in calculations and the readily available data provided by instruments.

**Type of Boiler under test: Coal fired Boiler.**

**Heat output data:**

Quantity of steam generated (output): 1815 TPH.

Steam pressure / temperature: 186.52 Bar.

Enthalpy of steam (dry & Saturated) at 10 kg/cm<sup>2</sup> (g) pressure: 868.64 Cal/kg

Feed water temperature: 277.60 C

Enthalpy of feed water: 291.41 Cal/kg

**Heat input data:**

Quantity of coal consumed (Input): 320TPH.

GCV of coal: 3682 k Cal/kg

Where  $Q$  = Quantity of steam generated per hour (kg/hr.)

$q$  = Quantity of fuel used per hour (kg/hr.)

GCV = Gross calorific value of the fuel (Cal/kg)



H = Enthalpy of steam (Cal/kg)

h = Enthalpy of feed water (Cal/kg)

$$\text{Boiler Efficiency } (\eta) = \frac{Q \times (H-h)}{q \times \text{GCV of Coal}} \times 100$$

$$= \frac{1815000 \times (868.64 - 291.41)}{320000 \times 3682} \times 100$$
$$= 89.17\%$$

#### 4.2 Indirect Method:

To calculate boiler efficiency using the indirect method, data on various losses incurred during boiler operation are required, including those mentioned above. Without specific data for the KTPS VII Stage 1×800 MW Thermal Power Plant in Kottagudem, Telangana State, accurate calculation of boiler efficiency by the indirect method is not feasible.

#### PARAMETERS OF 800MW BOILER

Fuel Firing Rate = 231450 kg/hr.

Steam Generation rate = 1625000 kg/hr.

Steam Pressure = 175.49 bar

Steam Temperature = 540°C

Feed Water Temp = 255°C

%CO<sub>2</sub> in Flue Gas = 14%

% CO in Flue Gas = 0.55 %

#### ANALYSIS OF FUEL:

Ash in Fuel = 36%

Moisture in Coal = 9%

Carbon Content = 46%

Hydrogen Content = 2.70%

Sulphur Content = 0.50%

Oxygen Content = 6.2%

#### BOILER EFFICIENCY BY INDIRECT METHOD:

##### Theoretical air requirement

$$= \frac{[(11.6 \times C) + \{34.8(H_2 - O_2)\} + (0.45 \times S)]}{100} \text{ Kg/Kg of coal}$$

$$= \frac{[(11.6 \times 43) + \{34.8(2.70 - 5.88)\} + (0.45 \times 0.48)]}{100} \text{ Kg/Kg of coal}$$

$$= 5.67\%$$

##### Find Theoretical CO<sub>2</sub>

(CO<sub>2</sub>%) t = Moles of C / Moles of N<sub>2</sub> + Moles of C

Where Moles of N<sub>2</sub> = Wt. of N<sub>2</sub> in theoretical air / Mole Wt of N<sub>2</sub> + Wt of N<sub>2</sub> in Fuel / Mole Wt. of N<sub>2</sub>

$$= \frac{6.027 \times 7710028 + 0.014928}{100} = 0.166227$$

$$\text{Where Moles of C} = \frac{0.4612}{100} = 0.03833$$

$$\text{Theoretical CO}_2\% = \frac{0.03833 \times 0.16627}{0.03833 + 0.16627} \times 100$$

$$= 18.73\%$$

##### Fixed Air Supplied: -

Actual CO<sub>2</sub> measured in flue gas = 14.2%

$$\% \text{ Excess Air Supplied EA} = \frac{7900[(CO_2\%) t - (CO_2\%) a]}{(CO_2\%) a \times [100 - (CO_2\%) t]}$$

$$= \frac{7900[18.73 - 14]}{14.2[100 - 18.73]}$$

$$= 32.842\%$$

**ACTUAL MASS OF AIR SUPPLIED**

Actual mass of air supplied/ kg of fuel (AAS) =  $\{1 + EA100\} \times \text{theoretical air}$   
=  $\{1 + 32.84100\} \times 6.027$   
= 8.0063 kg/ kg of coal

**ACTUAL MASS OF DRY FLUE GAS**

Mass of dry flue gas = Mass of CO<sub>2</sub> + Mass of N<sub>2</sub> Content in Fuel + Mass of N<sub>2</sub> in combustion Air Supplied + Mass of Oxygen in Flue Gas  
=  $0.4165 \times 4412 + 0.016 + 7.13 \times 77100 + (7.13 - 4.91) \times 23100$   
= 7.543 kg/kg of coal

**CALCULATIONS FOR LOSSES OF BOILER (Without Soot Blower):**

Without soot blower the average flue gas temperature = 220°C

Ambient Temperature = 35.54 °C

**1. % LOSS OF HEAT DUE TO DRY FLUE GAS: -**

$L1\% = m \times C_p \times (T_f - T_a) \times \text{GCV of Fuel} \times 100$   
=  $6.083 \times 0.23 \times (220 - 35.54) \times 3682 \times 100$   
= 7.0091%

**2. % LOSS OF HEAT DUE TO EVAPORATION OF WATER FORMED DUE TO H<sub>2</sub> IN FUEL: -**

$L2 = 9 \times H_2 \times \{584 + C_p \times (T_f - T_a)\} \times \text{GVC of Fuel} \times 100$   
 $L2 = 9 \times 0.027 \times \{584 + 0.45 \times (220 - 35.54)\} \times 3682 \times 100$   
= 4.40%

**3. % LOSS OF HEAT DUE TO MOISTURE PRESENT IN FUEL: -**

$L3 = M \times \{584 + C_p \times (T_f - T_a)\} \times \text{GCV of Fuel} \times 100$   
 $L3 = 0.09 \times \{584 + 0.45 \times (220 - 35.54)\} \times 3682 \times 100$   
= 1.630%

**4. % LOSS OF HEAT DUE TO MOISTURE PRESENT IN AIR:-**

$L4 = \text{AAS} \times \text{Humidity Factor} \times C_p \times (T_f - T_a) \times \text{GCV of Fuel} \times 100$   
 $L4 = 8 \times 0.0204 \times 0.45 \times (220 - 35.54) \times 3682 \times 100$   
= 0.3679%

**5. LOSS OF HEAT DUE TO INCOMPLETE COMBUSTION:**

$L5 = \%CO \times C\%CO + \%CO_2 \times 5744 \times \text{GCV of Fuel} \times 100$   
 $L5 = 0.55 \times 0.400.55 + 14 \times 5744 \times 3682 \times 100$   
= 2.35%

**6. LOSS OF HEAT DUE TO RADIATION AND CONVECTION:**

$L6 = 0.548 \times [(T_s / 55.55)^4 - (T_a / 55.55)^4] + 1.957 \times (T_s - T_a) \times 1.25 \times \text{sq.rt of } [(196.85 V_m + 68.9) / 68.9]$   
= **0.48 %**

**7. LOSS OF HEAT DUE TO UN BURNT IN FLY ASH (%):**

$\%L7 = (\text{Total ash collected/kg of fuel burnt}) \times \text{GCV of Fly Ash} \times \text{GCV of Fuel} \times 100$

% Ash in Coal = 34%

Ratio = 50:10

GCV of Fly Ash = 452.5 kcal/kg

Amount of Fly Ash =  $0.1 \times 0.34$

= 0.034

Loss of Heat in Fly Ash =  $0.034 \times 452.5$

= 15.385

$\%L7 = 15.385 \times 3682 \times 100$

= 0.4178%

**8. LOSS OF HEAT DUE TO UN BURNT IN BOTTOM ASH (%):**  $L_8 = (\text{Total Ash Collected / Kg of Fuel Burnt}) \times \text{GCV Of Bottom Ash GCV Of Fuel} \times 100$

GCV of Bottom Ash = 800 k Cal/kg

Amount of bottom ash in kg of coal =  $0.5 \times 0.34$   
 = 0.17

Loss of Heat in Bottom Ash =  $0.17 \times 800$   
 = 136

$\%L_8 = 136 / 3682 \times 100$   
 = 3.69%

Based on the provided data, the total losses for the boiler are calculated as follows:

Total Losses = Loss-1 + Loss-2 + Loss-3 + Loss-4 + Loss-5 + Loss-6 + Loss-7 + Loss-8  
 =  $(7.0091 + 4.40 + 1.630 + 0.3679 + 2.35 + 0.48 + 0.442 + 3.91) \%$   
 = 20.58%

Hence, the boiler efficiency via the indirect method (excluding the use of a soot blower) can be calculated as follows:

Efficiency of Boiler =  $100 - \% \text{ Total Losses}$   
 =  $100 - 20.58\%$   
 $\approx 79.41\%$

Thus, based on the provided data, the boiler efficiency using the indirect method (without the utilization of a soot blower) is estimated to be around 79.41%.

**5. Soot Blower:**

The facility is equipped with three types of soot blowers: 88 Water Wall Soot Blowers (WWSBs), 44 Long Retractable Soot Blowers (LRSBs), and 2 Air Heaters Soot Blowers (AHSBs). Among the 88 WWSBs, 22 are located below the Wind box, while the remaining 66 are distributed across three elevations above the Wind box.

Steam required for soot blowing is supplied from the outlet header of Divisional Palette, operating at a pressure of 25KSc and within a temperature range of 250-300°C. Pressure regulation to 25Kg/Cm<sup>2</sup> is maintained via a control valve, and all drain valves are kept open until the steam temperature exceeds 250°C. Additionally, a safety valve is installed in the line with an appropriate setting. Drain lines, comprising four from WWSBs, two from LRSBs, and two from AHSBs, are connected to the IBD flash tank (IBDFT).

Information gleaned from Kothagudem Thermal Power Plant VI Stage 1×800 MW indicates a preference for adopting the latest type of soot blowers to augment boiler efficiency, surpassing the capabilities of the current equipment.



**Fig. 1 Soot Blower**

**5.1 Boiler Efficiency Calculation Using the Indirect Method (Incorporating Soot Blowers):**

With soot blower the average flue gas temperature = 180°C

Ambient Temperature = 35.54 °C

Blowing Medium = Steam

**1. % LOSS OF HEAT DUE TO DRY FLUE GAS: -**

$(L_1\%) = m \times C_p \times (T_f - T_a) \times \text{GCV Of Fuel} \times 100$



$$=6.083 \times 0.23 \times (180 - 35.54) 3682 \times 100$$

$$= 5.489\%$$

**2. % LOSS OF HEAT DUE TO EVAPORATION OF WATER FORMED DUE TO H<sub>2</sub> IN FUEL: -**

$$L_2 = 9 \times H_2 \times \{584 + C_p \times (T_f - T_a)\} \times \text{GVC of Fuel} \times 100$$

$$L_2 = 9 \times 0.027 \times \{584 + 0.45 \times (180 - 35.54)\} 3682 \times 100$$

$$= 4.28\%$$

**3. % LOSS OF HEAT DUE TO MOISTURE PRESENT IN FUEL: -**

$$L_3 = M \times \{584 + C_p \times (T_f - T_a)\} \text{GCV of Fuel} \times 100$$

$$L_3 = 0.09 \times \{584 + 0.45 \times (180 - 35.54)\} 3682 \times 100$$

$$= 1.586\%$$

**4. %LOSS OF HEAT DUE TO MOISTURE PRESENT IN AIR: -**

$$L_4 = \text{AAS} \times \text{Humidity Factor} \times C_p \times (T_f - T_a) \text{ GCV Of Fuel} \times 100$$

$$L_4 = 8 \times 0.0204 \times 0.45 \times (180 - 35.54) 3682 \times 100$$

$$= 0.288\%$$

**5. LOSS OF HEAT DUE TO INCOMPLETE COMBUSTION:**

$$L_5 = \%CO \times C\%CO + \%CO_2 \times 5744 \times \text{GCV of Fuel} \times 100$$

$$L_5 = 0.55 \times 0.400.55 + 14 \times 5744 3682 \times 100$$

$$= 2.35\%$$

**6. LOSS OF HEAT DUE TO RADIATION AND CONVECTION:**

$$L_6 = 0.548 \times [(T_s / 55.55)^4 - (T_a / 55.55)^4] + 1.957 \times (T_s - T_a) 1.25 \times \text{sq.rt of } [(196.85 V_m + 68.9) / 68.9]$$

$$= 0.46 \%$$

**7. LOSS OF HEAT DUE TO UN BURNT IN FLY ASH (%):**

$$\%L_7 = (\text{Total ash collecctd/kg offuel burnt}) \times \text{GCVof Fly Ash} \text{GCV Of Fuel} \times 100$$

% Ash in Coal = 34%

Ratio = 50:10

GCV of Fly Ash = 452.5 kcal/kg

Amount of Fly Ash =  $0.1 \times 0.34$

= 0.034

Loss of Heat in Fly Ash =  $0.034 \times 452.5$

= 15.385

$$\%L_7 = 15.383682 \times 100$$

= 0.4178%

**8. LOSS OF HEATDUE TO UN BURNT IN BOTTOM ASH (%):**

$$L_8 = (\text{Total Ash Collected /Kg of Fuel Burnt}) \times \text{GCV Of Bottom Ash} \text{GCV Of Fuel} \times 100$$

GCV of Bottom Ash = 800 k Cal/kg

Amount of bottom ash in kg of coal =  $0.5 \times 0.34$

= 0.17

Loss of Heat in Bottom Ash =  $0.17 \times 800$

= 136

$$\%L_8 = 1363682 \times 100$$

= 3.69%

S.NO	LOSSES	% of LOSS
1	LOSS-1	5.489
2	LOSS-2	4.286
3	LOSS-3	1.586
4	LOSS-4	0.288
5	LOSS-5	2.35
6	LOSS-6	0.46

7	LOSS-7	0.4178
8	LOSS-8	3.69

Total Losses Total Losses =L1+L2+L3+L4+L5+L6+L7+L8  
 = (5.489+4.286+1.586+0.288+2.35+0.46+0.4424+3.91) %  
 = 18.814%

**Efficiency of Boiler by Indirect Method (without soot blower) =100(% Total Losses)**  
 =100-(18.58%)  
 = 81.18%

**5.2 Boiler Efficiency Calculation Using the Indirect Method (Incorporating Modern Soot Blowers):**

A lengthy extendable soot blower is employed to eliminate ash deposits across various sections of the boiler, such as the superheater, reheater, and economizer zones. Upon activation, the soot blower's lance tube and nozzle head extend and rotate within the boiler flue to dislodge ash accumulations on the heating surfaces, covering an effective blowing radius ranging from 2 to 2.5 meters. These soot blowers are engineered to endure flue gas temperatures of up to 1300°C. Following the soot blowing process, the lance tube retracts to prevent damage from the high-temperature flue gas.

In boiler operations, the buildup of soot and coking on heating surfaces is a prevalent issue, underscoring the necessity of installing a soot blower in power plants. Currently, steam soot blowers and sonic soot blowers constitute the two primary types found in power station boilers, with steam soot blowers being the most prevalent and efficient choice.

These specifications are pivotal for integrating modern soot blowers into the indirect method calculation used to determine boiler efficiency.



**Fig. 2 Modern Soot Blower**

**Specification of Soot blower:**

Soot blowing medium: Hot Air

Application field: Convection heating surfaces of boiler superheater, reheater, economizer

Valve material: Chromium-Molybdenum steel (Cr-Mo steel)

Maximum gas temperature: 500°C

Blowing time: 45-745 seconds

Blowing tube material: Chromium-Molybdenum steel or specialized steel suitable for boiler operating conditions

Steam consumption: 30-100 kilograms per minute.

Travel distance: 0.3-11 meters

Total weight: 200-770 kilograms



Blowing angle: 0°-360°

Effective blowing radius: 0.5-4.5 meters

Recommended blowing pressure: 0.8-1.5 Megapascals (Mpa)

Total weight: 200-1300 kilograms

### Design Features:

**Drive System:** The forward rotary movement of the lance is facilitated by a stationary motor and gearbox arrangement, employing a robust roller chain to drive an ACME lead screw and drive nut.

**Blowing Action:** The design of the soot blower allows it to cover distances ranging from 0.5 to 2.5 meters, featuring a generously sized feed tube that optimizes steam flow towards the convergent-divergent nozzles. These nozzles execute cleaning maneuvers in a helical pattern during both the forward and reverse strokes.

**Emergency Manual Operation:** In the event of a power failure, manual operation of the soot blower becomes possible using a provided crank handle. This crank securely attaches to the reduction gearbox/motor assembly on the blower casing, ensuring a safe and convenient manual operation.

**Manual Maintenance:** Key components, such as the main gear, are supported by self-lubricating phosphor bronze bearings, facilitating easy adjustment of the feed tube and valve steam packing through the maintenance access cover.

**Simple Installation:** For shorter stroke soot blowers, a cantilever support design option is available, eliminating the need for rear support structures. Mounting the blower directly onto the heater casing via a fabricated wall box with a sealed connection can significantly reduce the costs typically associated with constructing rear support structures.

**Loss of Heat Calculations for Modern Soot Blower:** Considering a modern soot blower, the average flue gas temperature is set at 140°C, with an ambient temperature of 35.74 °C. Air serves as the blowing medium in this configuration.

#### 1. % LOSS OF HEAT DUE TO DRY FLUE GAS: -

$$(L1\%) = m \times C_p \times (T_f - T_a) \text{GCV Of Fuel} \times 100 \\ = 6.083 \times 0.23 \times (140 - 35.74) / 3682 \times 100 \\ = 3.93\%$$

#### 2. % LOSS OF HEAT DUE TO EVAPORATION OF WATER FORMED DUE TO H<sub>2</sub> IN FUEL: -

$$L2 = 9 \times H_2 \times \{584 + C_p \times (T_f - T_a)\} \text{GVC of Fuel} \times 100 \\ L2 = 9 \times 0.027 \times \{584 + 0.45 \times (140 - 35.74)\} / 3682 \times 100 \\ = 4.14\%$$

#### 3. % LOSS OF HEAT DUE TO MOISTURE PRESENT IN FUEL: -

$$L3 = M \times \{584 + C_p \times (T_f - T_a)\} \text{GCV of Fuel} \times 100 \\ L3 = 0.09 \times \{584 + 0.45 \times (140 - 35.74)\} / 3682 \times 100 \\ = 1.543\%$$

#### 4. % LOSS OF HEAT DUE TO MOISTURE PRESENT IN AIR: -

$$L4 = AAS \times \text{Humidity Factor} \times C_p \times (T_f - T_a) \text{GCV Of Fuel} \times 100 \\ L4 = 8 \times 0.0204 \times 0.45 \times (140 - 35.74) / 3682 \times 100 \\ = 0.20\%$$

#### 5. LOSS OF HEAT DUE TO INCOMPLETE COMBUSTION:

$$L5 = \%CO \times C\%CO + \%CO_2 \times 5744 \text{GCV of Fuel} \times 100 \\ L5 = 0.55 \times 0.40 / 0.55 + 14 \times 5744 / 3682 \times 100 \\ = 2.35\%$$

#### 6. LOSS OF HEAT DUE TO RADIATION AND CONVECTION:

$$L6 = 0.548 \times [(T_s / 55.55)^4 - (T_a / 55.55)^4] + 1.957 \times (T_s - T_a) \times 1.25 \times \text{sq.rt of } [(196.85 V_m + 68.9) / 68.9] \\ = 0.42\%$$



**7. LOSS OF HEAT DUE TO UN BURNT IN FLY ASH (%):**

$$\%L7 = (\text{Total ash collected/kg of fuel burnt}) \times \text{GCV of Fly Ash} / \text{GCV Of Fuel} \times 100$$

$$\% \text{ Ash in Coal} = 34\%$$

$$\text{Ratio} = 50:10$$

$$\text{GCV of Fly Ash} = 452.5 \text{ kcal/kg}$$

$$\text{Amount of Fly Ash} = 0.1 \times 0.34$$

$$= 0.034$$

$$\text{Loss of Heat in Fly Ash} = 0.034 \times 452.5$$

$$= 15.385$$

$$\%L7 = 15.385 / 3682 \times 100$$

$$= 0.41\%$$

**8. LOSS OF HEAT DUE TO UN BURNT IN BOTTOM ASH (%):**

$$L8 = (\text{Total Ash Collected / Kg of Fuel Burnt}) \times \text{GCV Of Bottom Ash} / \text{GCV Of Fuel} \times 100$$

$$\text{GCV of Bottom Ash} = 800 \text{ k Cal/kg}$$

$$\text{Amount of bottom ash in kg of coal} = 0.5 \times 0.34$$

$$= 0.17$$

$$\text{Loss of Heat in Bottom Ash} = 0.17 \times 800$$

$$= 136$$

$$\%L8 = 136 / 3682 \times 100$$

$$= 3.69\%$$

S.NO	Losses	% of Loss
1	Loss-1	3.93
2	Loss-2	4.14
3	Loss-3	1.54
4	Loss-4	0.20
5	Loss-5	2.35
6	Loss-6	0.42
7	Loss-7	0.41
8	Loss-8	3.69

$$\text{Total Losses} = L1 + L2 + L3 + L4 + L5 + L6 + L7 + L8$$

$$= (3.93 + 4.14 + 1.54 + 0.20 + 2.35 + 0.43 + 0.41 + 3.69) \%$$

$$= 16.19\%$$

$$\text{Efficiency of Boiler by Indirect Method (with modern soot blowers)} = 100 - (\% \text{ Total Losses})$$


$$= 100 - (16.19\%)$$

$$= 83.81\%$$

**6. RESULTS & DISCUSSION****Graphical Comparisons:**

From the calculations graphs are plotted between all variable losses considering soot blower and without soot blower. The obtained differences are observed in the graph below. From these graphs main observations are listed in the table


Losses	Presence of Soot Blower	Modern Soot Blower
Loss-1	6.589	4.34
Loss-2	4.31	4.19
Loss-3	1.59	1.53
Loss-4	0.30	0.228
Loss-5	2.35	2.35
Loss-6	0.46	0.43
Loss-7	0.41	0.41
Loss-8	3.69	3.69

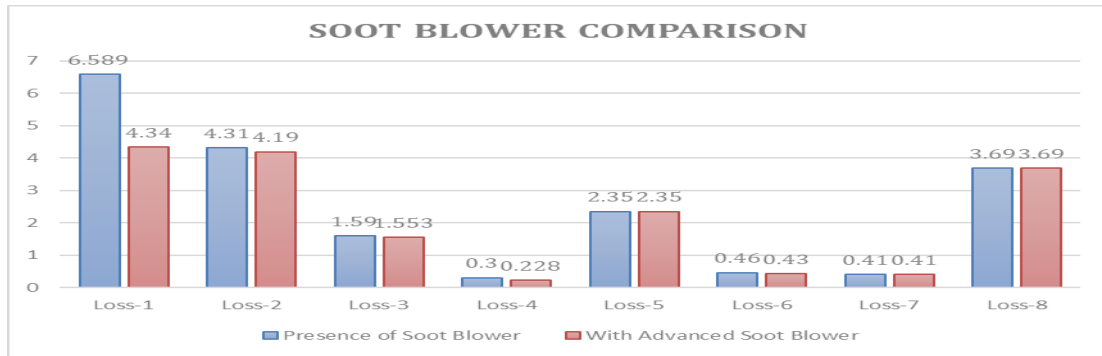

Graph. 1 Differenced in various heat losses considering with soot blower and modern soot blower. The graph depicts various efficiencies, including Efficiency without a soot blower, Efficiency with a soot blower, and Efficiency with a modern soot blower. The main observations derived from these graphs are catalogued in Table for reference.

Type of Blower	Efficiency of Boiler
Absence of soot blower	79.16%
Presence of soot blower	81.18%
With Modern Soot Blower	82.80%

Efficiency comparison for Absence of soot blower, with presence of soot blower and modern soot blower.

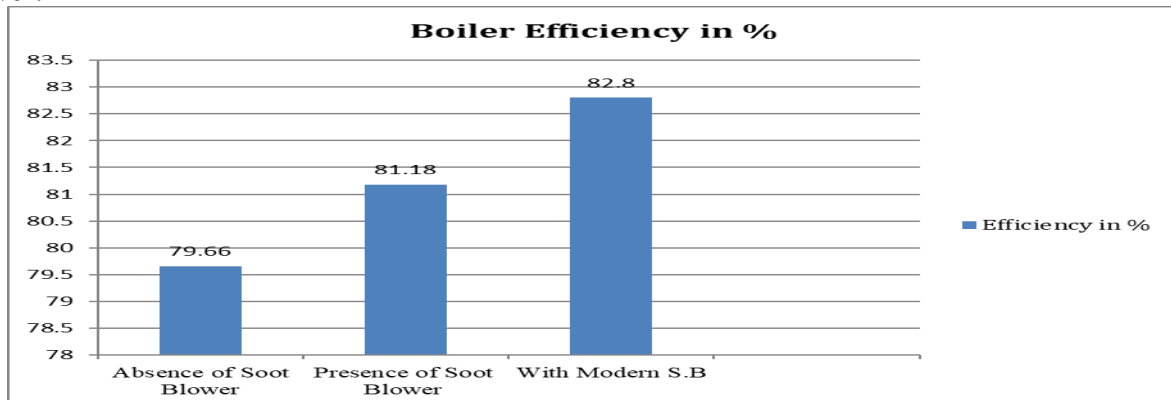


Graph: 2 Boiler Efficiency Comparison

The graph illustrates the plotted data regarding over losses under different conditions, namely without a soot blower, with a soot blower, and with a modern soot blower. The main observations derived from these graphs are summarized in Table 5.4 for further analysis and reference.

Type	Loss 1	Loss 2	Loss 3	Loss 4	Loss 5	Loss 6	Loss 7	Loss 8
<b>Absence of Soot blower</b>	7.0091	4.46	1.63	0.36	2.35	0.48	0.41	3.69
<b>Presence of soot blower</b>	6.589	4.31	1.59	0.30	2.35	0.46	0.41	3.69
<b>Modern soot blower</b>	4.34	4.19	1.553	0.228	2.35	0.43	0.41	3.69

All the losses with various types of soot blowers are discussed.

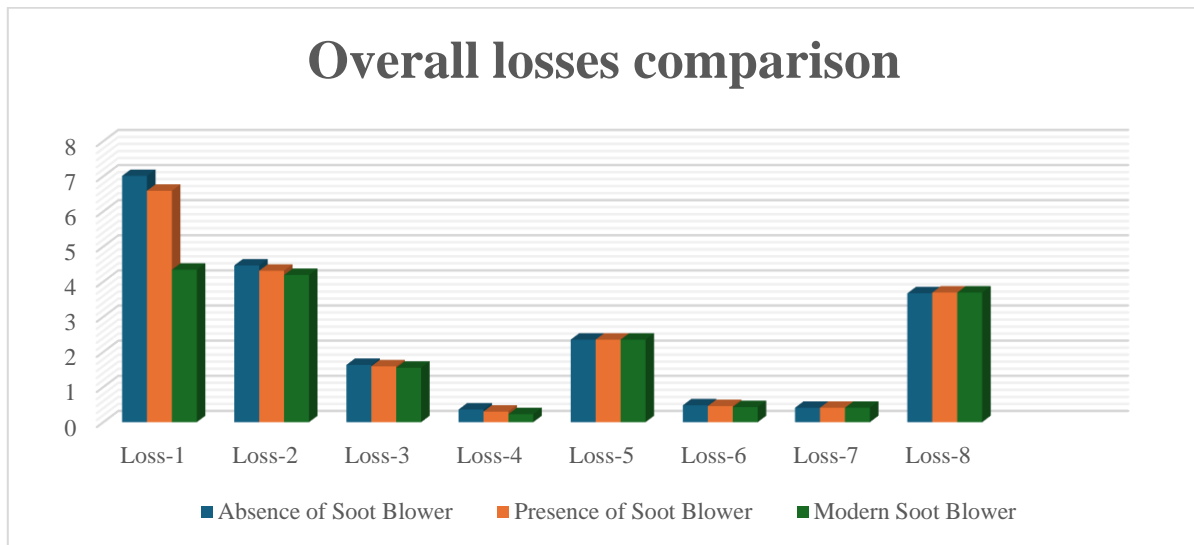

Graph: 3 Overall, Losses Comparison Graph

In the above all graphs unburnt losses in bottom ash and fly ash are not changed because of improper combustion this is due to low GCV of Fuel i.e. Coal once we will use high GCV of Coal these losses also reduced so we use Semi bituminous coal but it is costly. present here we use Indian Ignite coal of F grade the GCV of this coal is 3682 k Cal/kg so % ash in coal is 34%. But in semi bituminous coal GCV is 5800 k al/kg. So %ash in coal is 12.1%.

## 7. CONCLUSION

There are many factors influencing boiler efficiency, with heat losses being one of the key factors. Among these losses, heat loss due to dry flue gas is a significant contributor to reducing boiler efficiency. This is primarily caused by the hindered heat transfer rate between the water inside the economizer coil and the flue gases due to thick soot layers. This study focuses on effectively removing the soot from the coils to enhance the heat transfer rate, using a low-cost approach with modified soot blowers.

The modified soot blower aims to improve motor power and adjust lance length to effectively cover all the coils and remove the soot. Currently, the existing soot blowers in the plant are not very efficient, as they utilize steam as a medium. This inefficiency impacts boiler efficiency, as the soot from the coils is not effectively cleaned. With the existing blowers, the loss due to dry flue gas is measured at 6.58%. However, the suggested soot blowers utilize air as a medium, which is cost-free. This approach ensures that the boiler output is not affected, while effectively cleaning the soot from the coils.

As a result, the loss due to dry flue gas is projected to reduce significantly, by up to 3.93%. This improvement translates to an enhanced boiler efficiency of up to 83.81%.

## 8. REFERENCES:

- 1.Pankaj Sindu, Somvir Arya, "A Energy Audit Thermal Power Plant" International Journal of Exploring Emerging Trends In Engineering, Vol.01, Issue 03, Nov 2014.
2. Chetan Patel T, Dr.Bhavesh Patel K, Vijay Patel K, " Efficiency with Different Gcv Of Coal And Efficiency Improvement Opportunity In Boiler" International journal of innovative research in Science, Engineering and Technology, Vol. 2, Issue 5, May 2013
3. Vikas Duhan, Jitender Singh, "Energy Audit of Rajeev Gandhi Thermal Power Plant Hisar" International Journal for research Publication & seminar, Vol 05, Issue 02, March 2014
4. Moni Kuntal Bora, Nakkeeran S, "Performance Analysis from the Efficiency Estimation of Coal Fired Boiler" International Journal of Advanced Research, Vol.2, Issue 5, Pg. 561-574.
5. Kaliazine A, Cormack D E, Tran H and Jameel I, "Feasibility of using low pressure steam for soot blowing", Pulp & Paper, Energy Conservation, Vol.107.4, 2006, Pg.34.



6. Amit Kumar Jain, "An Optimal Preventive Maintenance Strategy for Efficient Operation of boiler in industry" International Institute for Science Technology and Education, Vol 02, Issue 04, 2012.
7. Gaurav T. Dhanre, Urvashi T. Dhanre, Krunal Mudafale, "Review Paper on Energy Audit of a Boiler in Thermal Power Plant" International Journal of Engineering Research and General Science Volume 2, Issue 6, October-November, 2014.
8. Venkata Seshendra Kumar Karri, "A Theoretical Investigation of Efficiency Enhancement in Thermal Power Plants" Modern Mechanical Engineering, 2012, 2, 106-113.
9. Namdeo D. Adate & R. N. Awale, "Energy Conservation through Energy Efficient Technologies at Thermal Power Plant" International Journal of Power System Operation and Energy Management ISSN 2231 – 4407, Vol-2, Issue-3, 4.
10. Sivathanu, A.K.; Subramanian, S. Extended Kalman filter for fouling detection in thermal power plant reheater. *Control. Eng. Pract* **2018**, 73, 91–99.
11. Sandberg, J.; Fdhila, R.B.; Dahlquist, E.; Avelin, A. Dynamic simulation of fouling in a circulating fluidized biomass-fired boiler. *Appl. Energy* **2011**, 88, 1813–1824.
12. Dong, M.; Han, J.; Li, S.; Pu, H. A Dynamic Model for the Normal Impact of Fly Ash Particle with a Planar Surface. *Energies* **2013**, 6, 4288–4307.
13. Shao, Y.; Wang, J.; Preto, F.; Zhu, J.; Xu, C. Ash Deposition in Biomass Combustion or Co-Firing for Power/Heat Generation. *Energies* **2012**, 5, 5171–5189.
14. Romeo, L.M.; Garetta, R. Neural network for evaluating boiler behaviour. *Appl. Therm. Eng.* **2006**, 26, 1530–1536.
15. Aliakbari, S.; Ayati, M.; Osman, J.H.; Sam, Y.M. Second-order sliding mode fault-tolerant control of heat recovery steam generator boiler in combined cycle power plants. *Appl. Therm. Eng.* **2013**, 50, 1326–1338.
16. Romeo, L.M.; Garetta, R. Fouling control in biomass boilers. *Biomass Bioenergy* **2009**, 33, 854–861.
17. Pena, B.; Teruel, E.; Díez, L. Soft-computing models for soot-blowing optimization in coal-fired utility boilers. *Appl. Soft Comput.* **2011**, 11, 1657–1668.
18. Dong, M.; Li, S.; Xie, J.; Han, J. Experimental Studies on the Normal Impact of Fly Ash Particles with Planar Surfaces. *Energies* **2013**, 6, 3245–3262.
19. Teruel, E.; Cortés, C.; Díez, L.I.; Arauzo, I. Monitoring and prediction of fouling in coal-fired utility boilers using neural networks. *Chem. Eng. Sci.* **2005**, 60, 5035–5048.
20. Perez, L.; Ladevie, B.; Tochon, P.; Batsale, J. A new transient thermal fouling probe for cross flow tubular heat exchangers. *Int. J. Heat Mass Transf.* **2009**, 52, 407–414.
21. Qiu, K.; Zhang, H.; Zhou, H.; Zhou, B.; Li, L.; Cen, K. Experimental investigation of ash deposits characteristics of co-combustion of coal and rice hull using a digital image technique. *Appl. Therm. Eng.* **2014**, 70, 77–89.
22. Kalisz, S.; Pronobis, M. Investigations on fouling rate in convective bundles of coal-fired boilers in relation to optimization of sootblower operation. *Fuel* **2005**, 84, 927–937.
23. Barrett, R.E.; Tuckfield, R.C.; Thomas, R.E. Slagging and Fouling in Pulverized-Coal-Fired Utility Boilers; A Survey and Analysis of Utility Data: Final Report; EPRI: Palo Alto, CA, USA, 1987; Volume 1.
24. Pattanayak, L.; Ayyagari, S.P.K.; Sahu, J.N. Optimization of sootblowing frequency to improve boiler performance and reduce combustion pollution. *Clean Technol. Environ. Policy* **2015**, 17, 1897–1906.
25. Valero, A.; Cortés, C. Ash fouling in coal-fired utility boilers. Monitoring and optimization of on-load cleaning. *Prog. Energy Combust. Sci.* **1996**, 22, 189–200.
26. Fan, Q.; Yan, W. *Boiler Principles*; China Electric Power Press: Beijing, China, 2007.
27. Shi, Y.; Wang, J.; Liu, Z. On-line monitoring of ash fouling and soot-blowing optimization for convective heat exchanger in coal-fired power plant boiler. *Appl. Therm. Eng.* **2015**, 78, 39–50.



28. Yan, W.; Chen, B.; Liang, X.; Xue, Y.E.; Wang, L.; Zhao, B. Investigation on Ash Monitoring Model for Rotary Air Heater in Utility Boiler. *Power Eng.* **2002**, 22, 1708–1710.
29. Pena, B.; Teruel, E.; Diez, L. Towards soot-blowing optimization in superheaters. *Appl. Therm. Eng.* **2013**, 61, 737–746.
30. Shi, Y.; Wen, J.; Cui, F.; Wang, J. An Optimization Study on Soot-Blowing of Air Preheaters in Coal-Fired Power Plant Boilers. *Energies* **2019**, 12, 958.